160008223867

中国认可
国际互认
检测
TESTING
CNAS L0223

XIHARI

No. 215696

检 验 报 告

TEST REPORT

试 品 型 号: TYPE	KYN28-24/1250-31.5
试 品 名 称: DESIGNATION	户内金属铠装移开式开关设备 INDOOR METAL CLAD REMOVABLE SWITCHGEAR
委 托 单 位: APPLICANT	南京奥博电气有限公司 NANJING AUBO ELECTRIC CO.,LTD.
制 造 单 位: MANUFACTURER	南京奥博电气有限公司 NANJING AUBO ELECTRIC CO.,LTD.
检 验 类 别: CLASSIFICATION	型式试验 （绝缘性能） TYPE TEST（DIELECTRIC PERFORMANCE）

西安高压电器研究院常州有限责任公司

XI'AN HIGH VOLTAGE APPARATUS RESEARCH INSTITUTE CHANGZHOU CO.,LTD.

说明
Information

1 本实验室拥有检验报告内相关内容（包括但不限于文字、数据、图片及页面设计、编排等）的版权和/或其他相关知识产权;本检验报告封面、目录、说明、检验结论、试品描述及试品确认页面为防伪页。

Copyright of the related contents (including but not limited to the word description, data, pictures and design of the pages, arrangement etc.) and/or other related intellectual property are owned to the laboratory; The front page, and pages-- "Table of Contents", "Information", "Conclusions", "Description of the test object" , "Identification of the test object" contain the anti-fake label.

2 仅下述情况不需要本实验室的书面许可：完整的复制本报告；或同时复制封面、目录页、说明页、检验结论页、试品描述页及试品确认页。

Only integral reproduction of this report, or reproduction of these pages--front page, "Table of Contents", "Information", "Conclusions", "Description of the test object" and "Identification of the test object" , are permitted without written permission from the laboratory.

3 检验报告无"检验检测专用章"及封印无效（电子报告除外）；检验报告无编写、校核、批准人签字无效；检验报告涂改无效。

The test report will become invalid if altered, or without the "Special stamp for test report", or the seal, or the original signature of "edited", "checked" and "approved".(Electronic test report except)

4 本检验报告仅适用于被试品，任何采用相同设计的同型号产品与被试品的一致性由制造单位负责。

This test report applies only to the test object. The responsibility for conformity of any apparatus having the same designations with that tested rests with the manufacturer.

5 本检验报告中未做特别说明的试验测量量的总不确定度不大于 5%。

Without special statement, the test overall measurement uncertainty is not greater than 5%.

6 本检验报告的试品和相关内容可能涉及专利,本实验室不承担识别这些专利以及由此引起的任何责任。

Test object and relevant content in this report may involve patent. The laboratory is not responsible for identifying these patents or any others.

7 本实验室出具的报告分为以下四种 XIHARI issue four categories of test report as below:

1）型式试验报告：报告包含了一个或多个型式试验系列，试验依据公认的标准实施并验证了制造商给出的额定值。Type Test Report: a report contains records of one or more series of type tests carried out strictly in accordance with a recognized standard, and the relevant ratings assigned by the manufacturer are verified;

注：对高压开关类型式试验报告包含 6 种基本形式:

note: The six basic type test reports for high-voltage switchgear and controlgear are as follows:

All copyrights reserved

——完整型式试验报告 Type Test Report of Complete Type Test

——绝缘性能型式试验报告 Type Test Report of Dielectric Performance

——温升性能型式试验报告 Type Test Report of Temperature Rise Performance

——短路/开断和关合性能型式试验报告 Type Test Report of Short-Circuit / Making and Breaking Performance

——开合性能型式试验报告 Type Test Report of Switching Performance

——内部电弧性能型式试验报告 Type Test Report of Internal Arc Performance

2）性能试验报告：报告包含了一项或多项试验，试验依照相关的标准实施，仅验证试品所做试验项目的性能。Performance Test Report: a report contains records of one or more tests carried out according to a related standards, only the performance conducted to the tests are verified.

3）研究性试验报告：报告包含了一项或多项试验，试验依照客户要求或参照相关标准实施。Researching Test Report: a report contains records of one or more tests carried out based on a recognized standard, or according to the client's instruction.

4）其它试验报告（委托试验报告、定型试验报告等）。Other (e.g. entrusted test report, prototype test report).

8 检验报告封面到结论页页面右下角无查询二维码无效。The entire report shall be considered invalid if there is no QR code in the bottom-right corner from the cover page to the "Conclusions " page.

联系方式 Contact information:
地址：江苏省常州市天宁区青洋北路 159 号 邮政编码 Zip code：213017
Address: No.159 Qing Yang North Street Changzhou Jiangsu P.R.China
电话 Tel：(+86)-0519-85505720 传真 Fax：(+86)-0519-85509750
网址 Web：www.xihari.com 电子邮箱 E-mail：lab@xihari.com

All copyrights reserved

目录
Table of contents

目录 Table of contents ---- 1
试品基本信息 Description of the test object ---- 2
检验结论 Conclusions ---- 4
试品确认 Identification of the test object ---- 5
测量不确定度 Measurement uncertainty ---- 11
报告中使用的符号和缩写 Symbols and abbreviation used in test report ---- 12
绝缘试验总则 General of dielectric test ---- 13
工频耐受电压试验 Power-frequency withstand voltage test ---- 14
雷电冲击耐受电压试验 Lightning impulse withstand voltage test ---- 17
辅助和控制回路的绝缘试验 Dielectric test on auxiliary and control circuit ---- 26
图纸 Drawings ---- 28

All copyrights reserved

试品基本信息
Description of the test object

型号名称: KYN28-24/1250-31.5 户内金属铠装移开式开关设备
Type and Designation: Indoor Metal Clad Removable Switchgear
委托单位: 南京奥博电气有限公司
Applicant: Nanjing Aubo Electric Co.,Ltd.
地址: 南京民族工业集中区（六合区竹镇镇内） (211500)
Address: Nanjing National Industrial Concentration Zone (Zhuzhen Town, Luhe District) (211500)
电话 Tel: 025-85281966-806 传真 Fax: 025-85282166
制造单位: 南京奥博电气有限公司
Manufacturer: Nanjing Aubo Electric Co.,Ltd.
地址: 南京市六合区竹镇镇竹丰路 15 号 (211500)
Address: No.15, Zhufeng Road, Zhuzhen Town, Luhe, Nanjing, Jiangsu, China (211500)
电话 Tel: 025-85281966-806 传真 Fax: 025-85282166

制造单位规定的试品主要技术数据 Main technical data assigned by the manufacturer:

额定电压 Rated voltage kV	24	
额定电流 Rated current A	1250	
额定频率 Rated frequency Hz	50	
额定短时耐受电流(主回路) Rated short-time withstand current (main circuit) kA	31.5	
额定峰值耐受电流(主回路) Rated peak withstand current(main circuit) kA	80	
额定短路持续时间(主回路) Rated duration of short-circuit(main circuit) s	4	
额定短时耐受电流(接地回路) Rated short-time withstand current (earthing circuit) kA	27.4	
额定峰值耐受电流(接地回路) Rated peak withstand current (earthing circuit) kA	69.6	
额定短路持续时间(接地回路) Rated duration of short-circuit (earthing circuit) s	2	
额定短时工频耐受电压 Rated short-duration power-frequency withstand voltage kV	65	✓
额定雷电冲击耐受电压 Rated lightning impulse withstand voltage kV	125	✓
额定短时工频耐受电压(真空断口) Rated power-frequency withstand voltage(across vacuum contact) kV	65	✓
额定雷电冲击耐受电压(真空断口) Rated lightning impulse withstand voltage(across vacuum contact) kV	125	✓

All copyrights reserved

额定短时工频耐受电压(隔离断口) Rated short-duration power-frequency withstand voltage(across the isolating distance) kV	79	✓
额定雷电冲击耐受电压(隔离断口) Rated lightning impulse withstand voltage(across the isolating distance) kV	145	✓
出厂日期及编号 Manufacture date and serial number	2021-08、AB20210061	

注 1：以上信息和数据由委托单位/制造单位提供，本实验室不对其准确性负责。

Note1: The above information and data are provided by Applicant/Manufacturer and the laboratory is not responsible for its accuracy.

注 2："✓" 表示该额定值在本检验报告中已得到验证。

Note2: "✓" This rating has been proved by the tests in this report.

All copyrights reserved

检验结论
Conclusions

型号名称: KYN28-24/1250-31.5 户内金属铠装移开式开关设备
Type and Designation: Indoor Metal Clad Removable Switchgear

委托单位: 南京奥博电气有限公司
Applicant: Nanjing Aubo Electric Co.,Ltd.

地址: 南京民族工业集中区（六合区竹镇镇内） (211500)
Address: Nanjing National Industrial Concentration Zone (Zhuzhen Town, Luhe District) (211500)

电话 Tel: 025-85281966-806 传真 Fax: 025-85282166

制造单位: 南京奥博电气有限公司
Manufacturer: Nanjing Aubo Electric Co.,Ltd.

地址: 南京市六合区竹镇镇竹丰路 15 号 (211500)
Address: No.15, Zhufeng Road, Zhuzhen Town, Luhe, Nanjing, Jiangsu, China (211500)

电话 Tel: 025-85281966-806 传真 Fax: 025-85282166

依据标准 Standards for Test Performance: GB/T 3906-2020

实施的项目 Test have been performed:

序号 Serial	项目 Items	参数 Parameters	判定标准 Standards for Verdict	结果 Result
1	工频耐受电压试验 Power frequency withstand voltage tests	相间及对地 Between phases, to earth: 65kV 1min 真空断口 Across vacuum contact: 65kV 1min 隔离断口 Across the isolating distance: 79kV 1min	GB/T 3906-2020 7.2	符合 Satisfied
2	雷电冲击耐受电压试验 Lightning impulse withstand voltage tests	相间及对地 Between phases, to earth: 125kV 真空断口 Across vacuum contact: 125kV 隔离断口 Across the isolating distance: 145kV	GB/T 3906-2020 7.2	符合 Satisfied
3	控制和辅助回路的绝缘试验 Dielectric tests on auxiliary and control circuits	2000V 1min	GB/T 3906-2020 7.2.11	符合 Satisfied

编写 Edited: 校核 Checked: 批准 Approved:

日期 Date: 2021-10-14 日期 Date: 2021-10-14 日期 Date: 2021-10-14

All copyrights reserved

试品确认
Identification of the test object

1、试品总体描述 General description of test object:

KYN28-24/1250-31.5 户内金属铠装移开式开关设备 Indoor Metal Clad Removable Switchgear

2、制造单位声明的试品主要构成元件如下 The main parts of test object assigned by manufacturer as follows:

1）断路器 Circuit-breaker

型号 Type: VS1-24/1250-31.5

额定电压 Rated voltage: 24kV

额定电流 Rated current: 1250A

额定频率 Rated frequency: 50Hz

额定短路开断电流 Rated short-circuit breaking current: 31.5kA

额定短路关合电流 Rated short-circuit making current: 80kA

额定短时耐受电流 Rated short-time withstand current: 31.5kA

额定峰值耐受电流 Rated peak withstand current: 80kA

额定短路持续时间 Rated duration of short-circuit: 4s

按照机械寿命的分类 Classification acc. mechanical endurance: M2

按照电寿命的分类 Classification acc. electrical endurance: E2

按照开合容性电流能力的分类 Classification acc.capacitive current switching: C2

额定操作顺序 Rated operating sequence: O-0.3S-CO-180s-CO

出厂日期 Manufacture date: 2021-05

出厂编号 Serial number: AB2105017

制造单位 Manufacturer: 南京奥博电气有限公司 Nanjing Aubo Electric Co.,Ltd.

2）固封极柱 Solid-insulation-embedded poles

型号 Type: HYD-24/1250-31.5

额定电压 Rated voltage: 24kV

额定电流 Rated current: 1250A

额定频率 Rated frequency: 50Hz

额定短路开断电流 Rated short-circuit breaking current: 31.5kA

出厂日期 Manufacture date: 2020-03

出厂编号 Serial number: A:2001451,B:2001453,C:2001457

制造单位 Manufacturer: 成都旭光电子股份有限公司 Chengdu Xuguang Electronics Co.,Ltd.

3）真空灭弧室 Vacuum interrupter

型号 Type: TD-24/1250-31.5

额定电压 Rated voltage: 24kV

All copyrights reserved

额定电流 Rated current: 1250A

额定频率 Rated frequency: 50Hz

额定短路开断电流 Rated short-circuit breaking current: 31.5kA

出厂日期 Manufacture date: 2020-03

出厂编号 Serial number: A:2001451,B:2001453,C:2001457

制造单位 Manufacturer: 成都旭光电子股份有限公司 Chengdu Xuguang Electronics Co.,Ltd.

4）操动机构 Operating device

型号 Type: 弹簧储能操动机构（与断路器一体）Spring operating mechanism(integrated with CB)

分闸线圈额定电压 Rated supply voltage of opening coil: DC220V

合闸线圈额定电压 Rated supply voltage of closing coil: DC220V

制造单位 Manufacturer: 南京奥博电气有限公司 Nanjing Aubo Electric Co.,Ltd.

5）接地开关 Earthing switch

型号 Type: JN15-24/31.5-275

额定电压 Rated voltage: 24kV

额定频率 Rated frequency: 50Hz

额定短时耐受电流 Rated short-time withstand current: 31.5kA

额定峰值耐受电流 Rated peak withstand current: 80kA

额定短路持续时间 Rated duration of short-circuit: 4s

配用操动机构型号、名称 Operating device: 手动弹簧操动机构 Manual operating mechanism

出厂日期 Manufacture date: 2020-03

出厂编号 Serial number: 20001715

制造单位 Manufacturer: 温州新机电器有限公司 Wenzhou New Machine Electric Co., Ltd.

6）电流互感器 Current transformer

型号 Type: LZZBJ9-24

额定电压 Rated voltage: 24kV

额定电流 Rated current: 1250A

额定频率 Rated frequency: 50Hz

额定短时耐受电流 Rated short-time withstand current: 31.5kA

额定峰值耐受电流 Rated peak withstand current: 80kA

额定短路持续时间 Rated duration of short-circuit: 4s

出厂日期 Manufacture date: 2020-03

出厂编号 Serial number: A:201041 C:201042

制造单位 Manufacturer: 江苏科兴电器有限公司 Jiangsu COSINE Electric Co.,Ltd.

7）试品外形尺寸 Overall dimension

宽 width × 深 depth × 高 height ： 1050 × 1825 × 2430mm × mm × mm

All copyrights reserved

8）母线 Busbar

主母线尺寸 Dimensions(main busbar): TMY-80 × 8mm × mm

接地母线尺寸 Dimensions(earthing busbar): TMY-40 × 4mm × mm

3、制造单位保证试品符合的技术文件 The test object is guaranteed by the manufacturer to comply with the following technical documents:

2AB.614.1JT KYN28-24/1250-31.5 户内金属铠装移开式开关设备 技术条件

Technical specification of KYN28-24/1250-31.5 Indoor Metal Clad Removable Switchgear

2AB.614.1SJ KYN28-24/1250-31.5 户内金属铠装移开式开关设备 试制鉴定大纲

To test the outline of identification of KYN28-24/1250-31.5 Indoor Metal Clad Removable Switchgear

4、制造单位提供并由实验室确认的图纸 Drawings submitted by the manufacturer and identified by the laboratory:

以下图纸编入本报告 The following drawings were attached in the report:

AB.630.001 总装图 General Assembly Drawing(日期 Date: 2021-07)

本实验室已确认制造单位提供的资料和图纸充分代表了试品的部件和零件，但不对这些资料和图纸细节的准确性负责。The laboratory is responsible for checking that the drawings and data schedules submitted adequately represent essential details of the equipment tested, but is not responsible for the accuracy of detailed drawings.

5、试品来源 Source of test object: 委托方送样 Provided by the applicant

6、样品确认日期 Date of identification of the test object: 2021-09-03

7、委托方代表 Tests witnessed by:

于朦朦 南京奥博电气有限公司

Yu Mengmeng Nanjing Aubo Electric Co.,Ltd.

8、检验日期 Date of tests: 2021-09-07

All copyrights reserved

试品照片 Photographs:



照片 Photo1



照片 Photo2

All copyrights reserved



照片 Photo3




照片 Photo4

All copyrights reserved



照片 Photo5

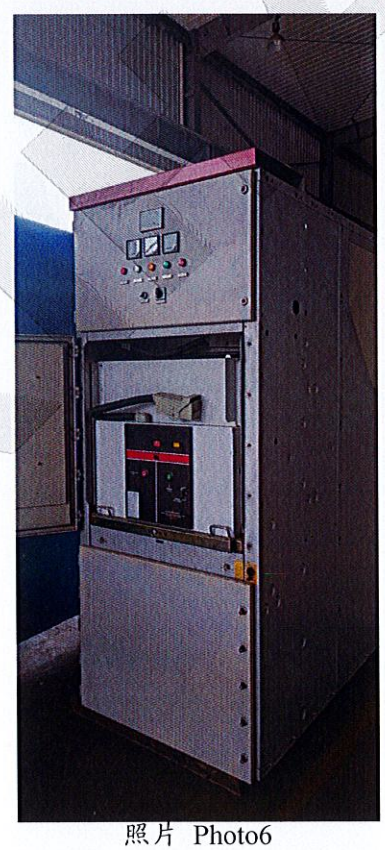

照片 Photo6

All copyrights reserved

测量不确定度
Measurement uncertainty

序号 NO	测量系统 (Measuring system)	扩展不确定度 (Expanded uncertainty)
1	电压测量系统 (Voltage measurement system)	$U<2\%$ (k=2)
2	冲击电压波形时间测量系统 (Time measurement system for impulse voltage waveform)	$U<5\%$ (k=2)
3	温度(Temperature) ZDR-F_{20}温湿度记录仪 ZDR-F_{20} Temperature and humidity recorder	U<1.0℃ (k=2)
4	绝对湿度(Absolute humidity) ZDR-F_{20}温湿度记录仪 ZDR-F_{20} Temperature and humidity recorder	U<1g/m^3 (k=2)
5	大气压力(Air pressure) DW476-1 数字压力计 DW476-1Digital pressure gauge	U<0.2 kPa (k=2)
6	雨水电导率(Rain conductivity) 530 电导率仪 530 Conductivity meter	U=1.2% (k=2)
7	局部放电测量系统 (PD measuring system)	< 20 pC: U=2.4pC (k=2) 20pC ~ 50pC: U=5.5pC (k=2) > 50 pC: U=12% (k=2)

All copyrights reserved

报告中使用的符号和缩写

Symbols and abbreviation used in test report

符号和缩写 Symbols and abbreviation used in test report	说明 Description
LI	雷电冲击 Lightning impulse
LIC	雷电冲击截波 Chopped lightning impulse
IG	冲击电压发生器 Impulse voltage generator
HV	高压 High voltage
LV	低压 Low voltage
PF	工频 Power frequency
P-to-P & P-to-E	相间及对地 Phase to phase and phase to earth
SN	编号 Serial number
NO.A	施加次数 Application number
NO.D	击穿次数 Discharge number
T-OSC	典型示波图 Typical Oscillogram
kVp	电压峰值 Voltage peak value
RMS	有效值 Root mean square
U_c	应施电压值 Expected voltage value
U_t	实测电压值 Measured voltage
K_a	海拔修正系数 Altitude correction factor
U_e	额定耐受电压值 Rated withstand voltage
U_p	相电压 Phase voltage
AID	隔离断口 Across the isolating distance
ISPW	观察窗 Inspection window
VCB	真空断路器 Vacuum circuit breaker
K_1	空气密度修正系数 Air density correction factor
K_{t1}	相间、相对地修正系数 Correction factor for P-to-P and/or P-to-E
K_{t2}	断口修正系数 Correction factor for across open switching device/isolating distance
K_u	辅助和控制回路的海拔修正系数 Altitude correction factor for dielectric test on auxiliary and control

All copyrights reserved

绝缘试验总则
General of dielectric test

1. 试品编号 Serial No: AB20210061;

2. 依据标准 Applied standard: GB/T 3906-2020;

3.试品是一个新的、干净的户内金属铠装移开式开关设备，包括断路器、真空灭弧室、操作机构、接地开关、电流互感器、母线及所有正常运行时的其它部件; Tested object is a new, clean indoor metalclad switchgear, including circuit breaker, vacuum interrupter, operating mechanism, earthing switch, current transformer, busbar and all other components as in service;

4.试品活门为非金属材料，有观察窗; Tested object has insulation shutter and inspection window;

5.试品最小电气间隙为: 对地 180mm，相间中心距 275mm; Minimum electrical clearance for tested object are, P-to-E 180mm, phase center distance 275 mm;

6.灭弧室编号为 Serial No. of vacuum interrupter: A:2001451,B:2001453,C:2001457;


7.试验过程中未更换和整修零部件; No part is renewed or reconditioned during the tests;

8.A、B、C 为动触头端，a、b、c 为静触头端，F 为试品外壳。A, B, C are moving contacts and a, b, c are fixed contacts, F is test object enclosure.

All copyrights reserved

工频耐受电压试验回路图

Power-frequency withstand voltage test circuit

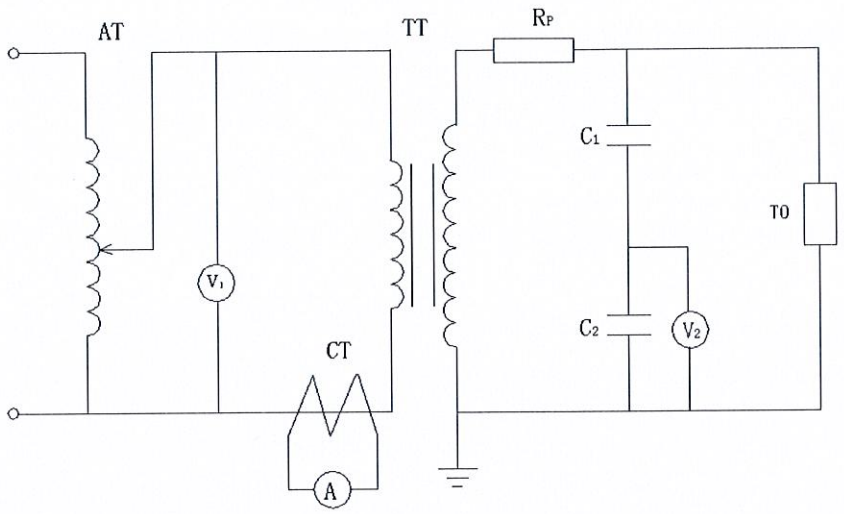

AT	调压器	Regulator	R_p	保护电阻	Protection resistance
CT	电流互感器	Current transformer	TT	工频试验变压器	PF transformer
TO	试品	Tested object	A	电流表	Currentmeter
C_1	高压臂电容	H.V arm capacitance	C_2	低压臂电容	L.V arm capacitance
V_2	峰值电压表(Voltmeter)		型号(Type): PV2-1A		编号(SN): 071261
150kV 工频电压测量系统 150kVPower frequency voltage measuring systems					

工频系统主要参数(Parameters of TT system)

U/S(kV/kVA)	f_{TT}(Hz)	R_p(kΩ)	C_1(pF)	C_2(μF)
150/300	50.0	5.0	500.0	0.5

All copyrights reserved

工频耐受电压试验

Power frequency withstand voltage test

试验日期：2021-09-07

试区大气条件 Atmospheric conditions: P=101.3kPa t=25.8℃ RH=67.9%

大气/海拔修正因数 Correction factor: K_{t1}=0.981 K_{t2}=/ K_1=/ K_a=/

试验部位 testing position	加压部位 voltage applied to	接地部位 earthed terminal	应施电压 U_c($kV_{r.m.s}$)	实测电压 U_t($kV_{r.m.s}$)	耐受时间 Duration (s)	加压次数 NO.A	击穿次数 NO.D
相间及对地① P-to-P & P-to-E	Aa	BCbcF ISPW	65.0	65.0	60	1	0
	Bb	ACacF ISPW		65.0	60	1	0
	Cc	ABabF ISPW		65.1	60	1	0
隔离断口① 静触头 (fixed)	上静 AID_{up}	下静 AID_{lower}	79.0	79.1	60	1	0
	下静 AID_{lower}	上静 AID_{up}		79.0	60	1	0
活门外表面① outer shutter	ABC	活门外表面 outer shutter	65.0	65.0	60	1	0
	abc	活门外表面 outer shutter		65.0	60	1	0
活门内表面① inner shutter	ABC	活门内表面 inner shutter	36.0	36.1	60	1	0
	abc	活门内表面 inner shutter		36.0	60	1	0
真空断口 VCB	A	BCabcF	65.0	65.1	60	1	0
	a	ABCbcF		65.0	60	1	0
	B	ACabcF		65.0	60	1	0
	b	ABCacF		64.9	60	1	0
	C	ABabcF		65.0	60	1	0
	c	ABCabF		65.0	60	1	0


试验结果 Test result: 通过 Passed。

注 Notes:


a)①$U_c=U_e\times K_{t1}\times K_a$，实际试验时取 K_{t1}=1.000Choosing K_{t1}=1.000 during test。

All copyrights reserved

试验照片
Photograph

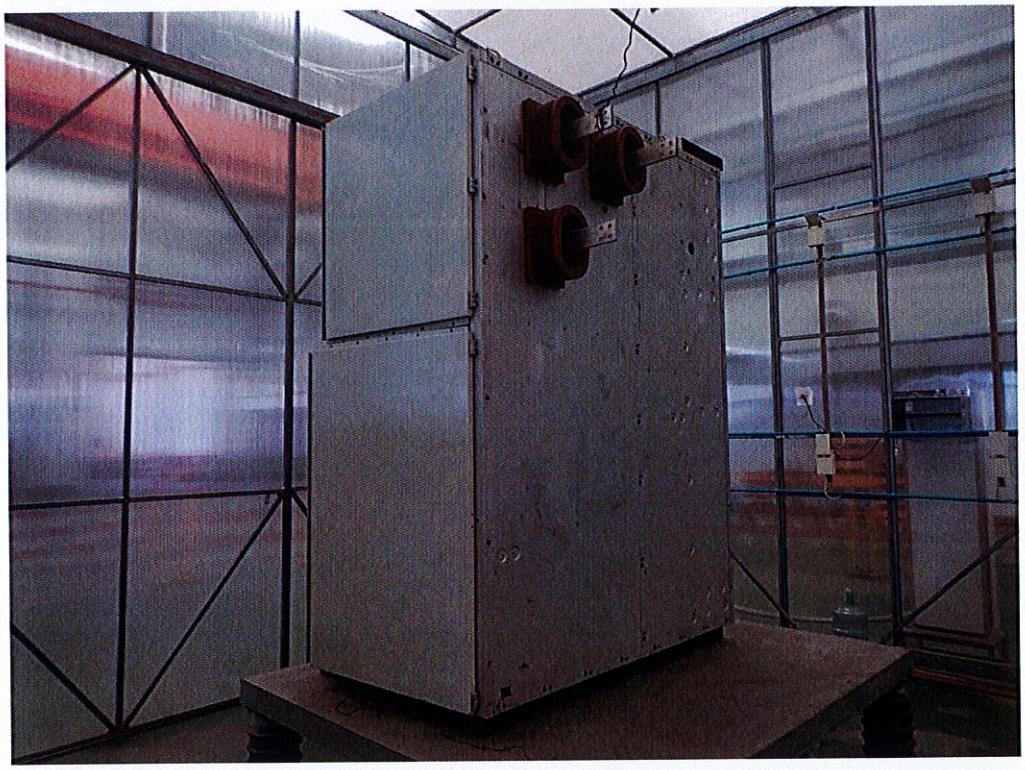

PFVZP215696-01

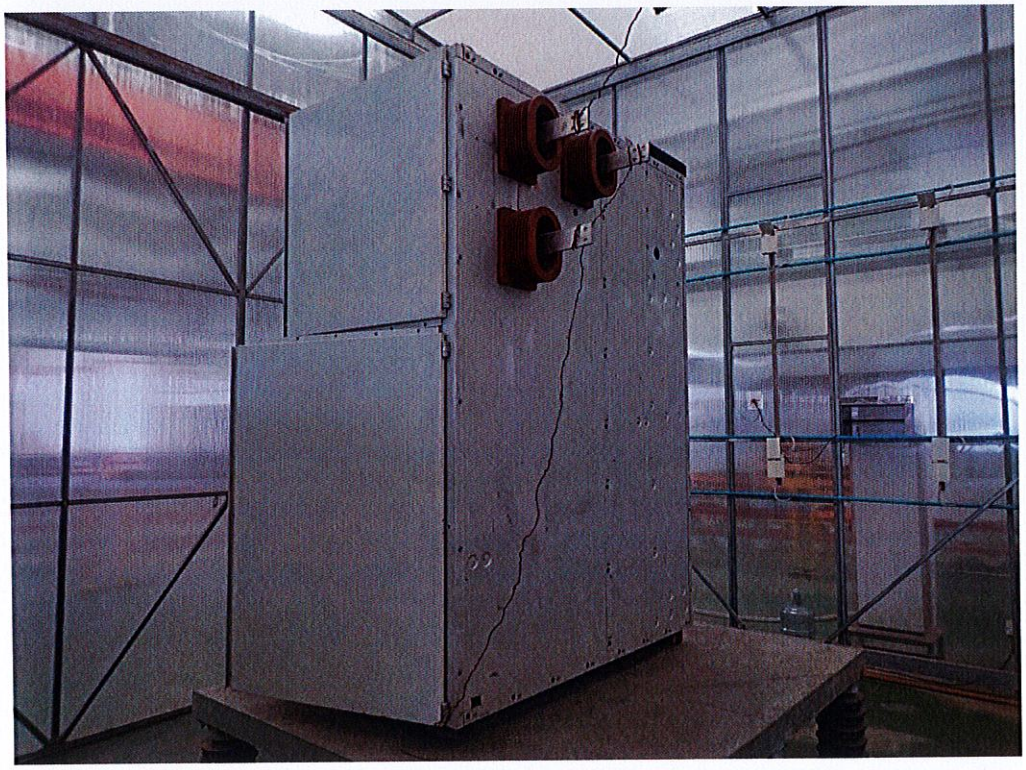


PFVZP215696-02

All copyrights reserved

雷电冲击耐受电压试验回路图

Lightning impulse withstand voltage test circuit

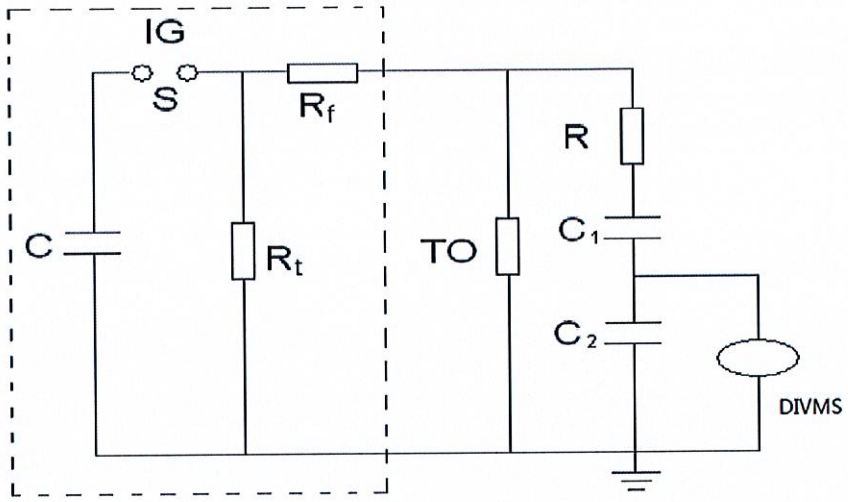

C	冲击发生器主电容	IG capacitance	R_f	波头电阻	Front resistance
R_t	波尾电阻	Tail resistance	S	冲击点火球隙	Sphere gap
R	阻尼电阻	Damping resistance	C_1	高压臂电容	H.V arm capacitance
TO	试品	Tested object	C_2	低压臂电容	L.V arm capacitance
DIVMS	数字冲击电压测量系统(Digital impulse voltage measuring systems)				
400kV/20kJ 冲击电压测量系统 400kV/20kJ Impulse voltage measuring systems					

冲击系统主要参数(Parameters of IG system)

波形(Type)	U(kV)	C(μF)	R_f(Ω)	R_t(Ω)	C_1(pF)	C_2(μF)
雷电 (LI)	400	0.25	465	213	300	0.555

All copyrights reserved

雷电冲击耐受电压试验
Lightning impulse withstand voltage test

试验日期 Testdate: 2021-09-07

试区大气条件 Atmospheric conditions: P=101.3kPa t=25.8℃ RH=67.9% 大气/海拔修正因数 Correction factor: K_{t1}=0.981 K_{t2}=/ K_1=/ K_a=/

试验部位 testing position	加压部位 voltage applied to	接地部位 earthed terminal	应施电压 U_c(kV_p)		实测电压值 U_t（kV_p）															加压次数 NO.A	击穿次数 NO.D	典型示波图 T-OSC
					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15			
相间及对地① P-to-P& P-to-E	Aa	BCbcF ISPW	125.0	+	125.4	125.7	124.8	125.7	124.8	125.4	124.6	124.7	125.6	125.2	125.1	124.6	124.9	125.4	124.6	15	0	01
				-	125.1	125.2	125.0	125.6	124.9	125.3	125.5	125.3	124.9	125.5	124.8	125.3	124.6	124.8	124.8	15	0	02
	Bb	ACacF ISPW		+	125.6	124.6	125.4	125.6	125.7	125.4	125.2	125.6	125.8	125.1	124.9	125.4	125.3	124.6	125.4	15	0	03
				-	125.8	125.8	125.6	125.7	124.7	125.7	124.9	124.6	125.7	124.6	125.7	124.5	124.6	125.2	125.7	15	0	04
	Cc	ABabF ISPW		+	124.8	125.6	124.8	125.4	125.5	125.6	125.7	124.8	125.1	125.2	124.7	125.7	124.5	125.1	124.5	15	0	05
				-	125.3	125.5	125.4	124.9	124.7	125.0	124.8	124.5	125.6	124.7	125.4	125.0	125.3	124.8	125.5	15	0	06
隔离断口①（静触头）(fixed contact) AID	上静 AID_{up}	下静 AID_{lower}	145.0	+	145.5	144.3	145.1	144.9	145.2	144.9	145.8	145.4	145.6	145.8	145.2	144.4	144.5	144.5	145.4	15	0	07
				-	145.1	144.9	145.0	145.2	145.0	144.4	145.4	144.7	145.8	144.5	144.3	144.8	145.2	144.6	144.3	15	0	08
	下静 AID_{lower}	上静 AID_{up}		+	145.6	144.7	144.4	145.3	144.7	145.7	144.4	145.6	144.8	145.8	145.6	145.0	144.5	145.7	145.8	15	0	09
				-	144.9	144.7	144.4	145.1	144.5	145.4	145.0	144.6	144.6	144.9	145.3	144.4	144.9	144.9	144.4	15	0	10
活门外表面① outer shutter	ABC	活门外表面 outer shutter	125.0	+	124.7	125.2	124.8	125.1	125.0	124.8	124.9	125.4	125.6	124.6	124.9	125.1	125.3	125.2	125.1	15	0	11
				-	125.0	124.6	124.6	125.4	125.7	125.1	125.0	124.6	125.3	125.5	125.7	124.7	125.5	125.6	125.0	15	0	12
	abc	活门外表面 outer shutter		+	125.5	124.8	124.9	125.4	124.8	125.7	125.5	125.6	125.6	124.5	124.6	125.3	125.4	125.7	124.6	15	0	13
				-	124.6	124.8	125.2	125.5	124.9	125.6	125.0	124.6	125.1	125.5	125.0	125.3	125.2	125.0	125.4	15	0	14

试验结果 Test result: 通过 Passed。

注 Notes: a)①$U_c=U_e\times K_{t1}\times K_a$，实际试验时取 K_{t1}=1.000; Choosing K_{t1}=1.000 during test;

b)施加了一次 50%的 U_c进行调波，分别施加 65%和 80%的 U_c对波形进行校验。50%,65%,80%U_c are applied in sequence to verify parameters。

All copyrights reserved

雷电冲击耐受电压试验
Lightning impulse withstand voltage test

试验日期：2021-09-07

试区大气条件 Atmospheric conditions: P=101.3kPa t=25.8℃ RH=67.9%大气/海拔修正因数 Correction factor: K_{t1}=/ K_{t2}=/ K_1=/ K_a=/

试验部位	加压部位	接地部位	应施电压 U_c (kV_p)		实测电压值 U_t(kV_p)															加压次数 NO.A	击穿次数 NO.D	典型示波图 T-OSC
					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15			
真空断口 VCB	A	BCabcF	125.0	+	125.2	125.0	124.9	125.1	125.7	124.8	125.7	125.3	125.1	125.0	124.6	124.8	124.5	125.3	125.0	15	0	15
				-	124.8	124.9	124.7	125.1	125.7	125.4	125.5	124.9	124.9	125.2	124.7	124.6	124.9	124.6	124.5	15	0	16
	a	ABCbcF		+	125.4	125.5	125.0	124.9	124.7	125.4	125.4	124.8	125.3	125.5	125.1	125.2	125.4	125.4	125.7	15	0	17
				-	125.6	125.7	124.9	124.8	125.3	124.8	125.7	124.6	125.7	125.5	125.2	125.2	125.0	125.6	125.1	15	0	18
	B	ACabcF		+	125.7	125.0	125.5	125.3	124.9	124.7	124.5	124.8	125.4	124.8	125.6	124.6	124.7	125.4	124.6	15	0	19
				-	125.3	125.1	125.1	125.2	124.6	124.7	125.0	124.9	125.5	124.9	125.2	124.9	125.6	125.7	125.4	15	0	20
	b	ABCacF		+	125.3	124.7	125.1	124.9	125.0	125.0	124.7	125.7	125.7	124.5	124.8	125.4	125.0	125.7	124.8	15	0	21
				-	125.7	125.7	124.7	125.7	124.8	125.7	124.8	124.8	125.4	125.1	124.9	125.1	124.6	125.3	124.9	15	0	22
	C	ABabcF		+	125.2	125.0	125.2	124.7	125.7	124.8	125.4	124.7	124.7	125.4	125.1	125.5	125.7	124.9	124.7	15	0	23
				-	125.5	124.8	125.4	125.4	125.6	125.6	125.6	125.4	125.4	124.5	124.5	125.3	125.1	124.8	125.3	15	0	24
	c	ABCabF		+	125.2	125.3	124.9	124.6	125.4	125.1	125.2	124.9	125.6	125.3	125.2	125.6	125.0	124.8	124.5	15	0	25
				-	125.7	125.4	125.8	125.5	125.0	125.5	125.6	125.7	125.7	124.8	125.4	125.5	124.6	124.9	125.6	15	0	26


试验结果 Test result: 通过 Passed。

注 Notes:


a)施加了一次 50%的 Uc 进行调波，分别施加 65%和 80%的 Uc 对波形进行校验。50%,65%,80%Uc are applied in sequence to verify parameters。

All copyrights reserved


示波图
Oscillogram

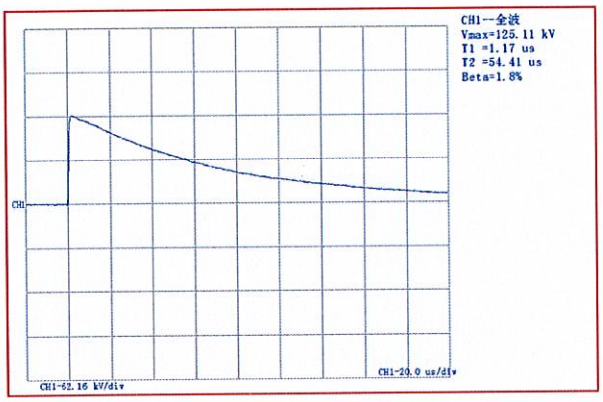


IPVBT215696--01

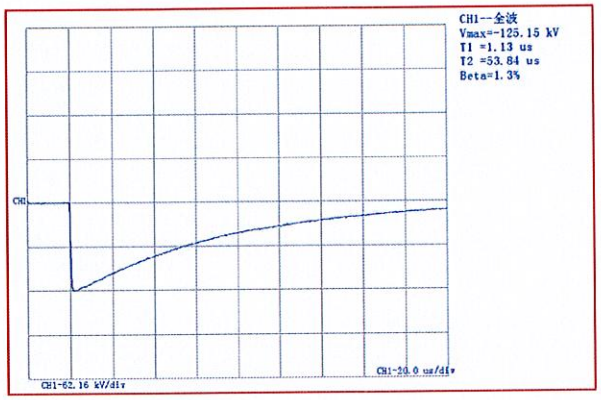


IPVBT215696--02

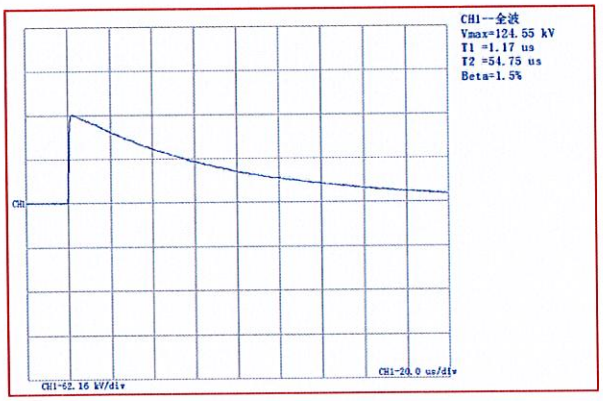


IPVBT215696--03

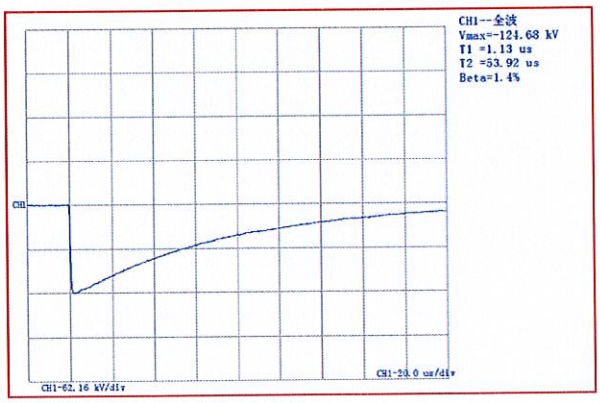

IPVBT215696--04

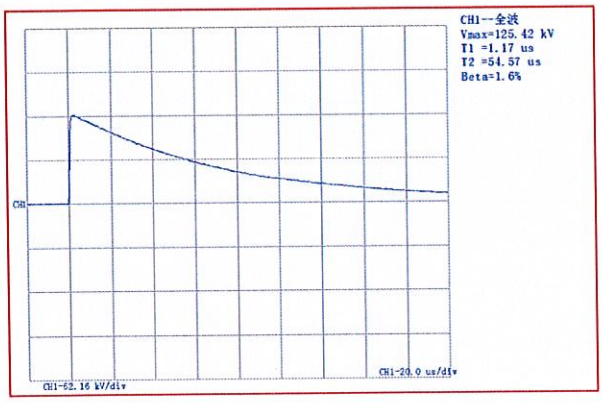


IPVBT215696--05

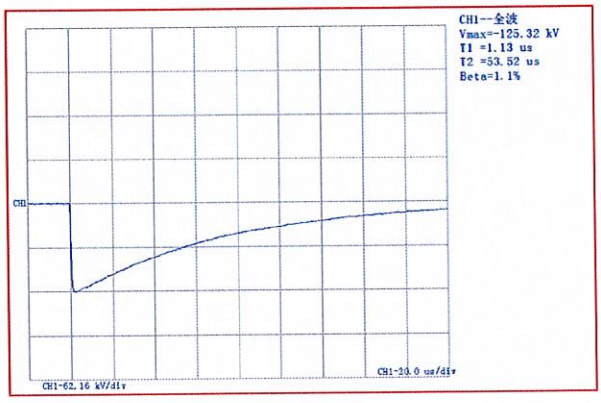


IPVBT215696--06


All copyrights reserved

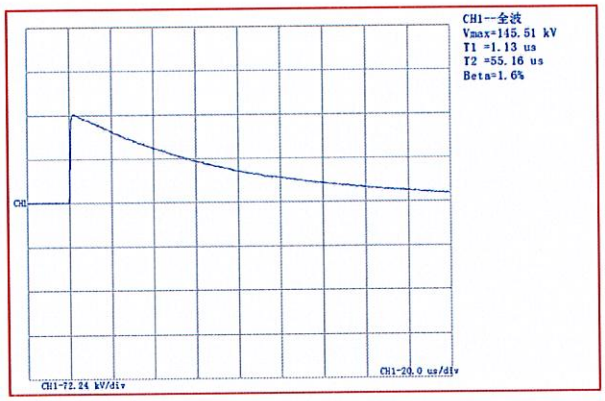


IPVBT215696--07

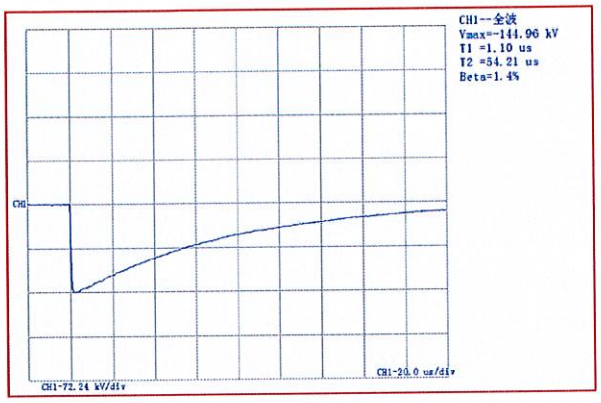


IPVBT215696--08

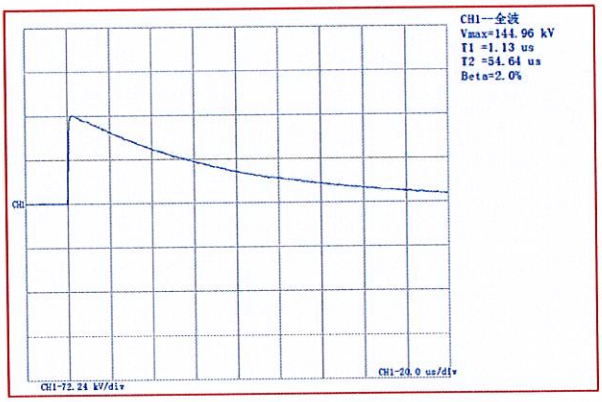


IPVBT215696--09

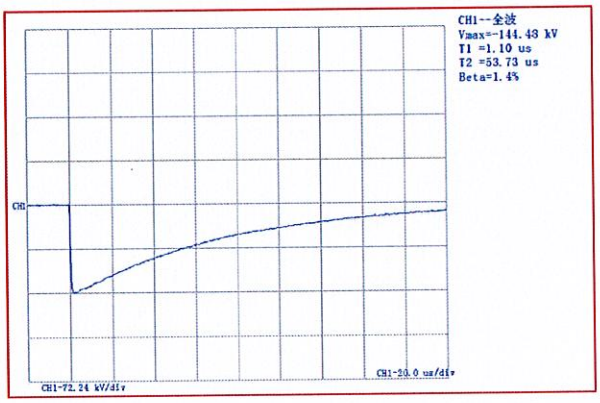

IPVBT215696--10

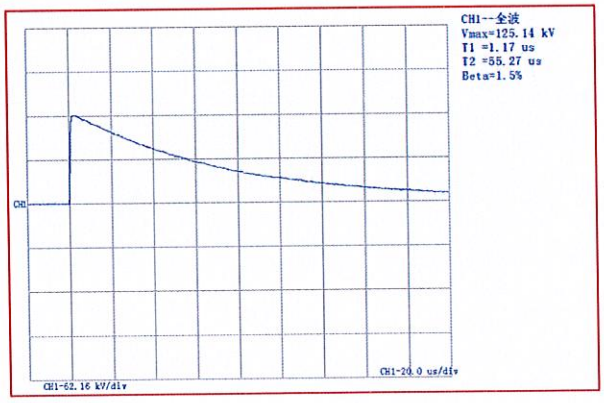


IPVBT215696--11

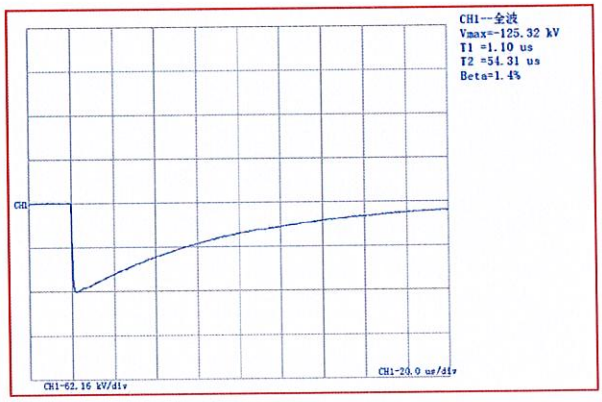


IPVBT215696--12


All copyrights reserved

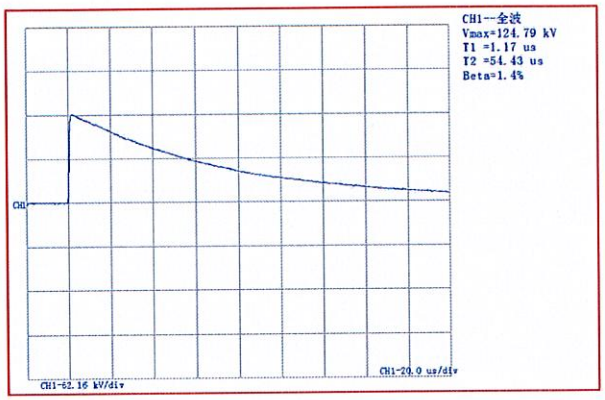


IPVBT215696--13

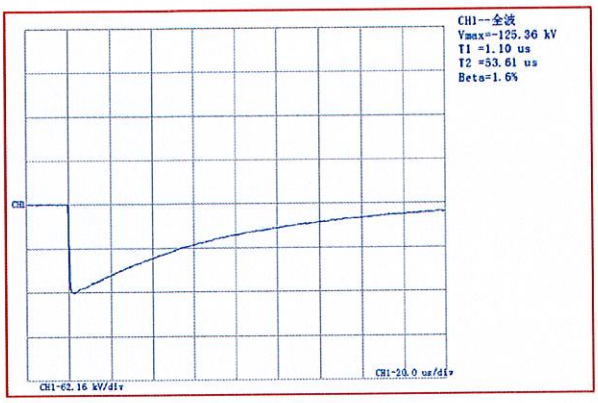


IPVBT215696--14

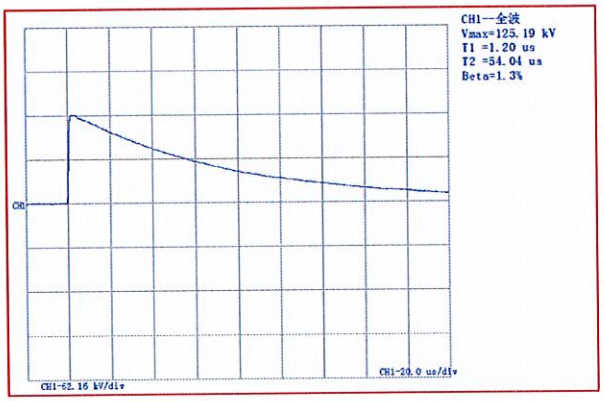


IPVBT215696--15

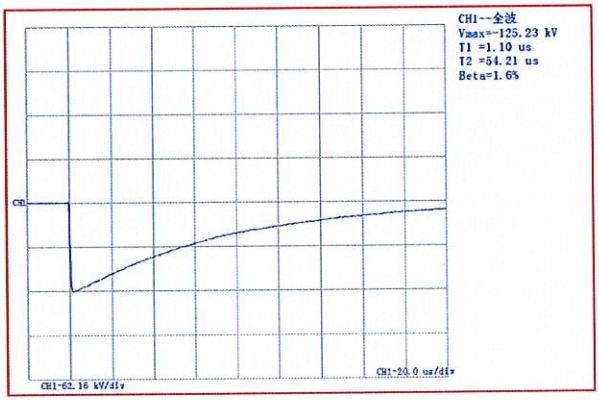

IPVBT215696--16

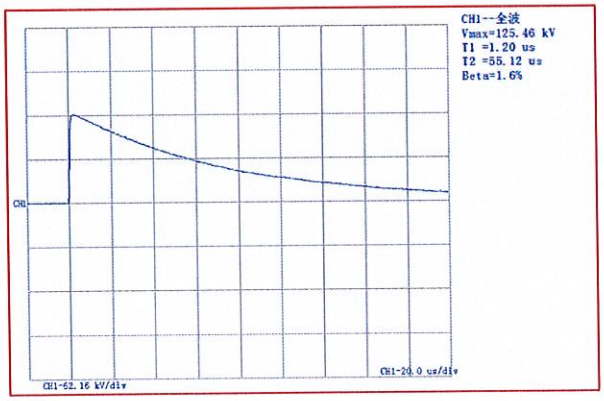


IPVBT215696--17

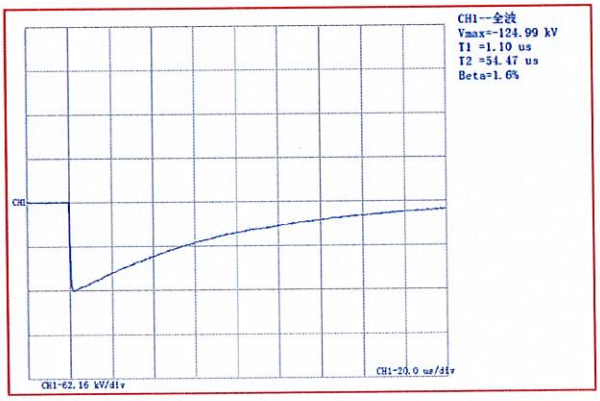


IPVBT215696--18


All copyrights reserved

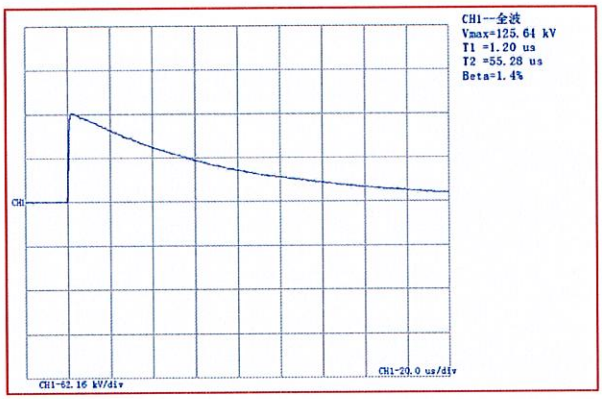


IPVBT215696--19

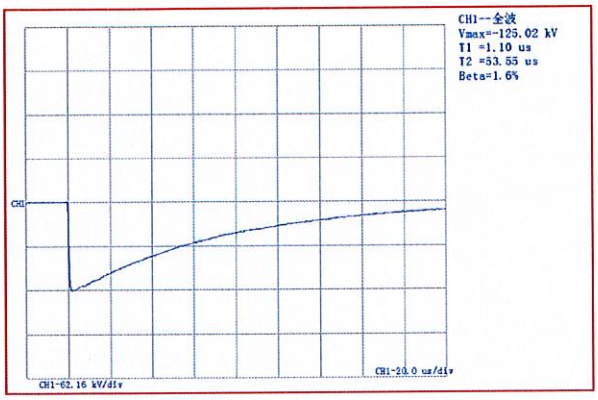


IPVBT215696--20

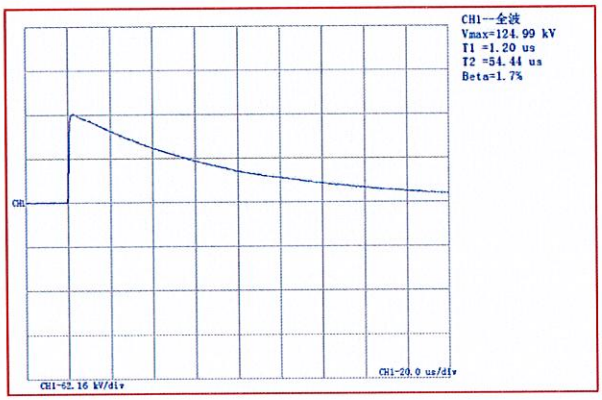


IPVBT215696--21

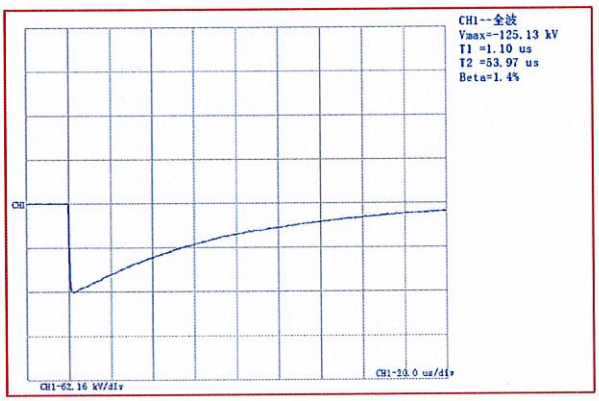

IPVBT215696--22

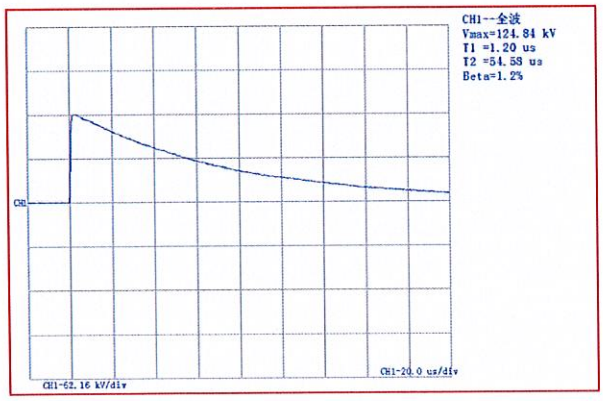


IPVBT215696--23

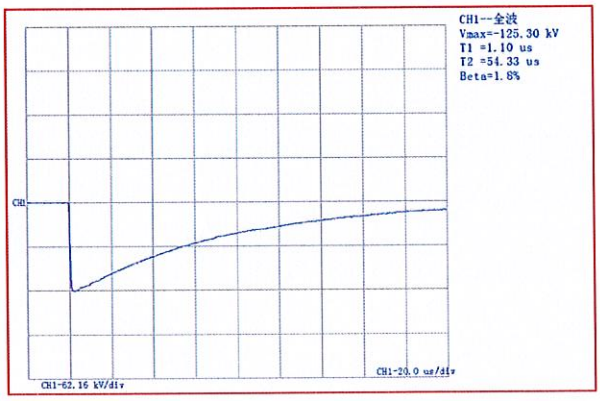


IPVBT215696--24

All copyrights reserved

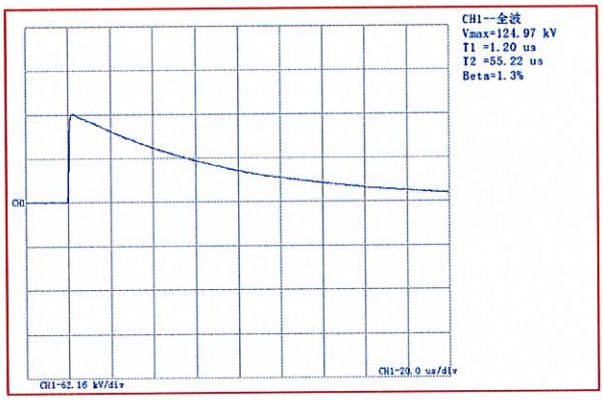


IPVBT215696--25

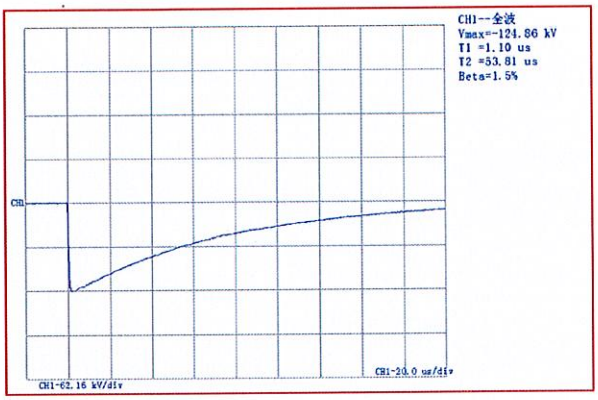


IPVBT215696--26

All copyrights reserved

试验照片
Photograph

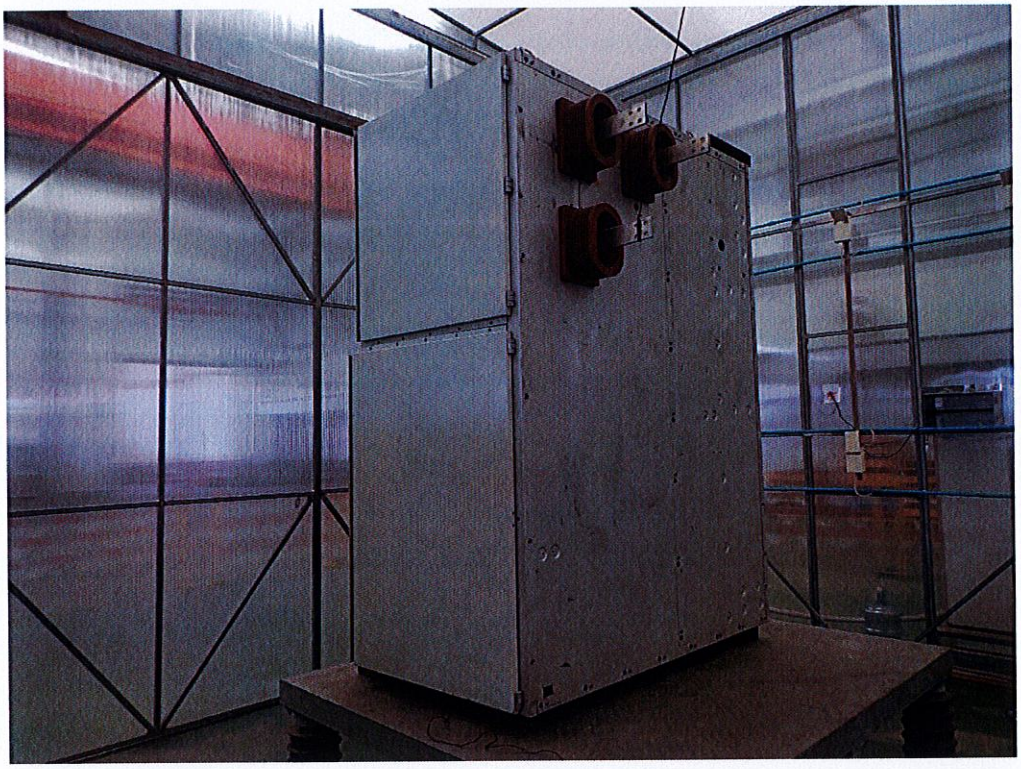

IPVZP215696-01

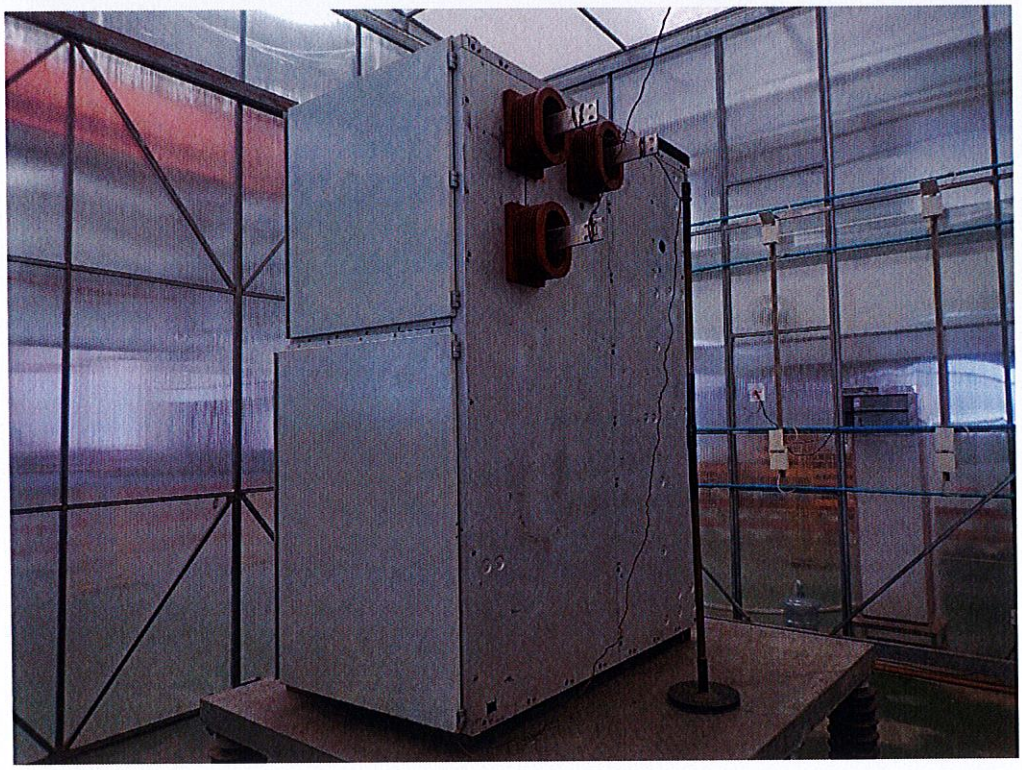

IPVZP215696-02

All copyrights reserved

辅助和控制回路的绝缘试验

Dielectric test on auxiliary and control circuit

试验日期 Test date: 2021-09-07

试区大气条件 Atmospheric conditions: P=101.3kPa t=25.8℃ RH=67.9%

大气/海拔修正因数 Correction factor: K_{t1}=0.981 K_{t2}=/ K_1=/ K_u=/

a)电压加在连接在一起的辅助和控制回路与开关装置的底架之间 Voltage applied betweenthe auxiliary and control circuit connected together as a whole and the frame of the switching device

试验部位 testing position	加压部位 voltage applied to	接地部位 earthed terminal	应施电压 U_c(kVr.m.s)	实测电压 U_t(kVr.m.s)	加压次数 NO.A	击穿次数 NO.D	典型示波图 T-OSC
辅助和控制回路 auxiliary and control circuit	二次回路端子 secondary terminals	F	2.0	2.0	1	0	/

b)电压加在辅助和控制回路的每一部分（这部分在正常使用中与其他部分绝缘）与连接在一起并和底架相连的其他部分之间 Voltage applied betweeneach part of the auxiliary and control circuits,which in normal use may be insulated from the other parts, and the other parts connected together to the frame

试验部位 testing position	加压部位 voltage applied to	接地部位 earthed terminal	应施电压 U_c($kV_{r.m.s}$)	实测电压 U_t($kV_{r.m.s}$)	加压次数 NO.A	击穿次数 NO.D	典型示波图 T-OSC
辅助和控制回路 auxiliary and control circuit	各二次回路端子 each secondary terminals	其它二次回路端子与 F other secondary terminals & F	2.0	2.0	1	0	/

试验结果 Test result: 通过 Passed。

注 Notes:

a)持续时间 Duration: 1min;

b)$U_c=U_e\times K_{t1}\times K_u$，实际试验时取 K_{t1}=1.000Choosing K_{t1}=1.000 during test。

All copyrights reserved


试验照片
Photograph



PFVZP215696-03

All copyrights reserved

图纸
Drawings

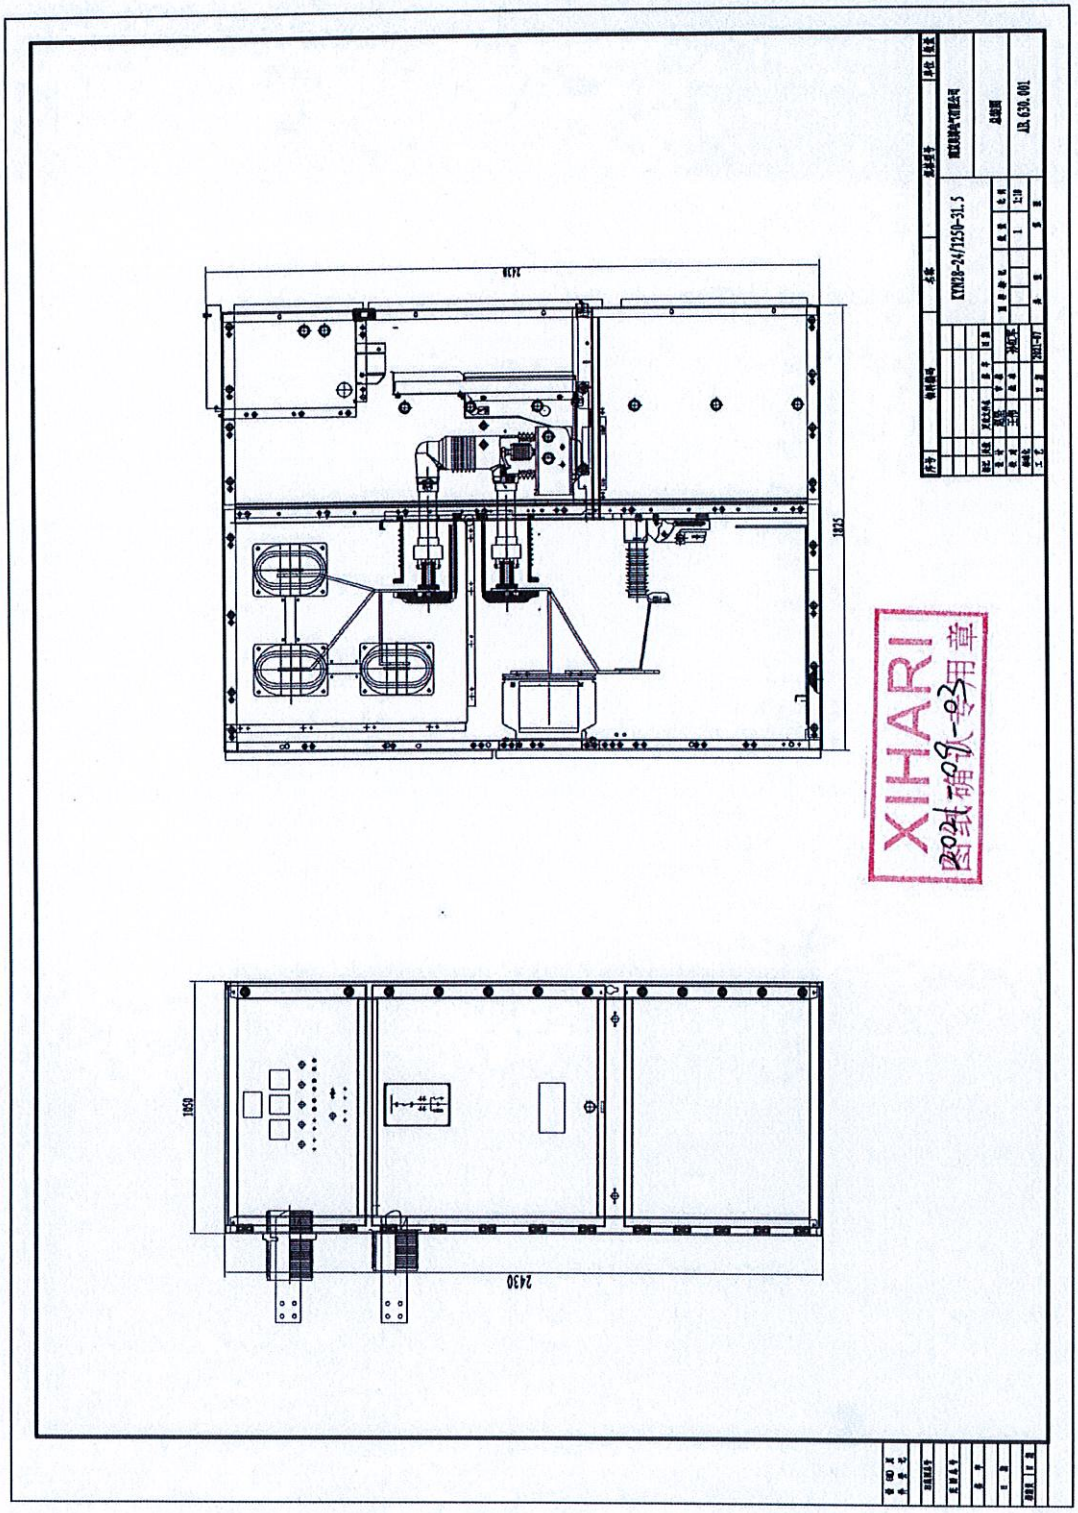

All copyrights reserved